

Technical note

Making isolated renewable energy systems more reliable

Luiz A. de S. Ribeiro^a, Osvaldo R. Saavedra^{a,*}, Shigeaki. L. Lima^a, José G. de Matos^a, Guilherme Bonan^b^a Electrical Energy Institute, Federal University of Maranhão, São Luís, MA, Brazil^b R&D Department, CP Eletrônica S.A, Porto Alegre, RS, Brazil

ARTICLE INFO

Article history:

Received 8 November 2010

Accepted 3 February 2012

Available online 8 March 2012

Keywords:

Hybrid systems

Micro-turbines

Standalone systems

ABSTRACT

A hybrid renewable energy system (HRES) uses several kinds of sources, including wind and solar, to make better use of the natural resources in standalone applications. A common application of HRES is in remote communities, where interconnected electrical grid is unreachable due to economics and physical reasons. Due to the long distance and difficult access to these isolated areas, electrical generation systems used in these applications must be reliable. And the reliability of the system, especially the inverter used to regulate the AC voltage, is one of the main problems associated to these systems, and it is responsible for the lack of confidence in renewable systems at several locations in Brazil. This paper shows the results of using renewable hybrid systems specially designed for isolated areas, focusing attention on reliability, efficiency and expansion flexibility. It presents the system description, mode of operation, inverter design, and experimental results measured in a pilot plant located in Lençóis Island, a small isolated community in the north region of Brazil.

© 2012 Elsevier Ltd. All rights reserved.

1. Introduction

The supply of electricity to isolated communities in Brazil and other developing countries, in general, is still done in a precarious way, using diesel generators, which operate for 3–4 h a day [1,2]. This has happened mostly due to the high cost associated with the expansion of the conventional power grid to these communities. In some cases, technical and environmental constraints also have been factors that have prevented the full electrical service in these communities, especially those located on oceanic islands.

For societies to have or attempt to maintain a sustainable development it is necessary a lot of effort in the discovery and use of renewable energy sources as well as in the increase of the efficiency in the processing of use these energy sources. In this aspect, the electric power generation based on solar photovoltaic and wind turbines technologies has been effective in distributed generation systems and also in standalone systems for supplying isolated communities [3,4]. In standalone systems, those solutions have been shown appropriate for areas of difficult access, dispersed, with environmental restrictions or with a population formed by low-income people, even when these adverse characteristics represent a difficulty for the sustainability of the designed generation system. Technical and operational troubles, and supply

interruptions are difficult to be solved due to the non availability of technical assistance. The delay of remote assistance leads to long periods of lack of electrical service, causing loss of credibility in this kind of system [5,6]. Thus, to overcome these difficulties, isolated systems must be projected taking into account reliability, minimizing the dependence of maintenance and human intervention, mainly because it is expensive and quite often not available.

2. Critical issues to feasibility

The factors that most influence the reliability of standalone systems based on renewable energy are the following [5–8]:

1. *Protection coordination*: inadequate coordination leads to increased number of customers without electric service due to faults;
2. *Distribution network in marine environment*: distribution network exposed to aggressive marine environment are more vulnerable to mechanical failures and fatigue, phase- ground faults and hot spots in connections;
3. *Intermittent nature of renewable resources*: solar and wind energies have an intermittent nature, contrasting with the need to provide continuous and reliable energy;
4. *Voltage regulation*: the voltage of power distribution systems generated from intermittent sources must fulfill the power quality standards of conventional distribution systems;

* Corresponding author.

E-mail address: o.saavedra@ieee.org (O.R. Saavedra).

5. *Short circuits and faults in general*: requires adequate protections;
6. *Power inverter*: the dependence of unique inverter is critical for feasibility;
7. *Maintenance*: distance, natural obstacles and population with poor economic conditions make difficult the maintenance of isolated systems.

These critical issues must be addressed in order to make reliable the operation of isolated renewable energy based systems. A practical example is the system installed on the Island of Lençóis in the northeast of Brazil. This autonomous system was projected to provide electrical power 24 h a day for a community formed by approximately 390 inhabitants distributed in 90 homes. At the end of 10 years of operation, the full power consumption of the island was estimated to be approximately 6,800 kWh a month. This estimation takes into account the residential, small businesses, public agencies (school and health post) consumptions, and the consumption of a small ice factory with an average of 720 kg/day.

Fig. 1 shows a panoramic view of the Island. At right side, wind micro-turbines are observed.

3. Mixing renewable energy sources

Solar and wind energies are sources frequently available in most of isolated applications. However, they are intermittent in nature, contributing to energy supply with low reliability. To reduce this effect and to improve reliability, a practical solution is to mix these sources, obtaining the so called hybrid systems. Unfortunately, some difficulties still remain: the quality of energy must meet the standards set by regulatory agencies; what to do when all the primitive sources are not available? A well designed renewable hybrid generation system must meet some basic requirements in order to have power quality and its autonomy should be such that it achieves the community expectations. The simplified block diagram of the proposed system is presented in Fig. 2. It is formed by a solar sub-system, a wind sub-system, a battery bank, a backup diesel generator, an inverter system, and a sub-system of control and management based on a programmable logical controller (PLC).

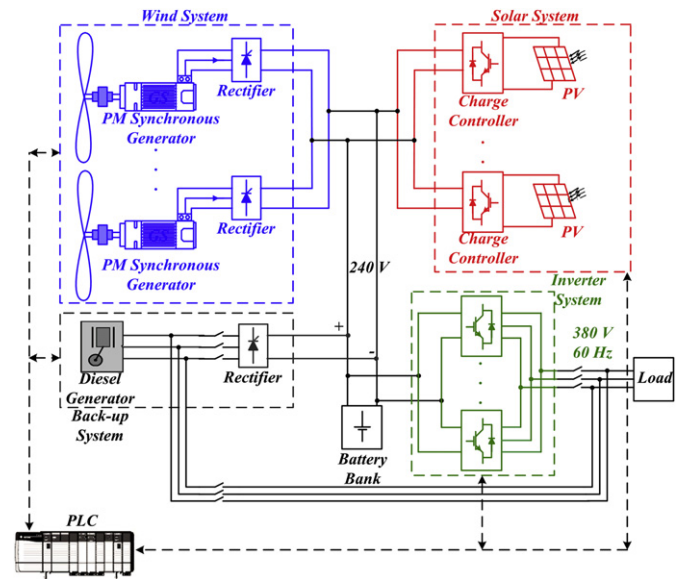


Fig. 2. Block diagram of the hybrid power system.

The solar sub-system is composed of 9 PV strings in parallel, each one formed by 18 photovoltaic modules in series. The strings were installed on the roof of the powerhouse as illustrated in Fig. 3. Each string has a controller to provide the correct charging of the battery bank. The total maximum power of this sub-system is approximately 21 kWp.

The electrical specifications of the solar modules that were used are shown in Table 1. Its electrical characteristics (current versus voltage as a function of temperature and solar irradiation) are shown in Fig. 4.

The wind sub-system is formed by three small wind turbines, each one with 3 blades up wind, BCW EXCEL-R/240 model (battery charging version), manufactured by Bergey WindPower [9]. These turbines were installed near the sea, on towers with 30 m high, as shown in Fig. 5. The wind generators are three-phase permanent magnet synchronous type, with an exterior rotor drum type with



Fig. 1. View of island of Lençóis, Maranhão Brazil.



Fig. 3. The solar sub-system.

Table 1

Electrical specifications of the solar module.

Maximum power	130 W
Tolerance	+10%/–5%
Maximum power voltage	17.6 V
Maximum power current	7.39 A
Open circuit voltage	21.9 V
Short circuit current	8.02 A
Rated temperature for cell operation	47° C
Current temperature coefficient	$[3.18 \times 10^{-3}] \text{ A/C}^\circ$
Voltage temperature coefficient	$[-8.21 \times 10^{-2}] \text{ V/C}^\circ$

Note: These values are valid under standard tests conditions with irradiation of 1 kW/m^2 , Spectrum 1.5 Air Mass and cell temperature equal to 25°C .

38 poles. The AC output voltage is rectified to charge the battery bank. Others technical specifications of each turbine, got from the owner's manual, are presented in Table 2. The turbine power curve is shown in Fig. 6 for a sea level site, with air density of 1.225 kg/m^3 , 10% of turbulence factor, and 30 m high tower [9].

The solar and wind sub-systems work in parallel to charge a bank composed of 120 batteries, arranged in 6 parallel strings, each formed by 20 batteries of 150 Ah in series. The nominal voltage of the bank is 240 VDC. The batteries technical specifications, according to the manufacturer data, are summarized in Table 3. The system control is configured for a maximum depth of discharge (DOD) of battery bank equal to 30%. With this DOD it is expected that the battery bank can supply the load continuously for 8 h in case of lack of sun and or wind.

There is also a 53 kVA diesel generator as a backup unit to be used eventually during the lack of the primary energy sources or when the renewable power generation sub-systems are on maintenance.

The DC bus is the input of the inverter sub-system. It is formed by two three-phase inverters, each one with rated power of 20 kVA, configured to work in parallel, sharing equally the load. It is important to notice that there isn't any communication interface between these units or data exchange.

The automatic management of the system is done by a programmable logic controller (PLC), which is responsible by the coordination of the parallel operation of all sources, with special attention to the system efficiency.

The generation system is installed in the Northeast of Brazil, coordinates $1^\circ 18' 55.81'' \text{S}$ and $44^\circ 52' 41.40'' \text{W}$. The solar potential for electrical generation in this site is summarized in Table 4. These data were obtained from the Brazilian solarimetric map, available in [10]. The installed power of the solar sub-system is 21.06 kW. By considering the functional characteristics of the charger controller and the conversion system efficiency, the net maximum power of the solar sub-system is around 85% of the gross installed power, e.g., 17.69 kW. Multiplying this value by the monthly radiation in $\text{kWh/m}^2/\text{day}$ and by the number of days in a particular month, it is found an estimate of the monthly generated energy, as shown in last line of Table 4.

The wind potential for electrical energy generation of the area under investigation is summarized in Table 5. These data were obtained from the Atlas of the Brazilian Wind Potential, available in [11]. The estimated values for the mean power and the mean generated energy presented in Table 5 were calculated using the Weibull probability density and the turbines power curve, using the

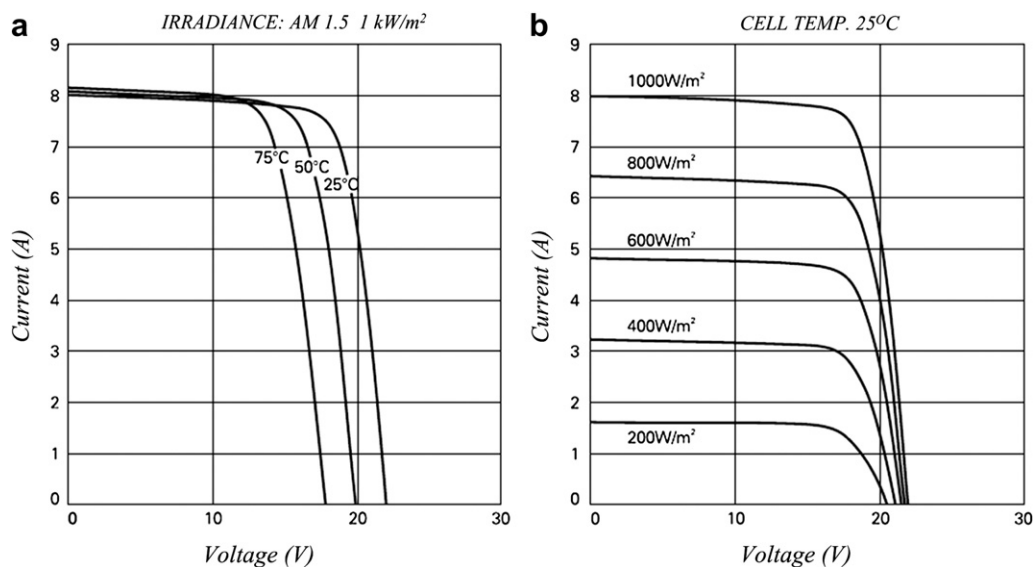


Fig. 4. Solar module characteristics of current versus voltage: a) as function of the temperature and b) as function of the solar irradiation.



Fig. 5. The wind sub-system (tower height: 30 m).

values of the mean wind speed and the Weibull K factor shown in the first two lines of this table [9,12].

Table 6 shows the energy balance between the expected power generation and the expected energy consumption. The residential consumption was estimated considering the expected use of appliances, lighting, etc., by local residents. The productive consumption is related to the installation of a small ice factory to meet the needs of local fishermen. It is also included in the total energy consumption the energy used in public lighting. As can be seen only in March, April, and May it is expected a deficit in the generation from the renewable sources. In these months part of the energy supply is expected to be from the diesel generator. The expected excess of energy in the other months must be discharged.

Table 7 shows measurements for solar generation sub-system during the months of March to July of 2010. As can be seen the maximum power generation are of the same order of magnitude as the net installed power of the solar panel, which is 17.67 kW ($\approx 0.84 \times 21$ kW). It is also possible to see that the values measured for the Mean Generated Energy in each month have similar magnitude if they are compared with the estimated values shown in Table 4.

Table 8 shows power and energy supplied by just one turbine of the wind generation sub-system from March to July of 2010. The daily average power and average generated energy are relatively smaller than the respective values that were estimated for these variables in Table 5. The main reason of this discrepancy was the abnormal wind pattern observed in this specific period as compared to previous years. Another reason for this discrepancy is related to the fact that in the estimation of power generated by one turbine, it was considered as if it was working alone. In the Lençóis Island Generation System, on other hand, the turbines work in parallel with the PV sub-system to charge the same battery bank. So, it is possible

Table 2
Specifications of the wind turbines.

Start-up wind speed	3.1 m/s
Cut-in wind speed	3.5–4.5 m/s
Rated wind speed	12.4 m/s
Furling wind speed	15.7 m/s
Maximum design wind speed	54 m/s
Rotor diameter	7 m
Rotor speed	0–350 RPM
Rated power with battery charger	7–8.5 kW
Output rated voltage	240 VCC

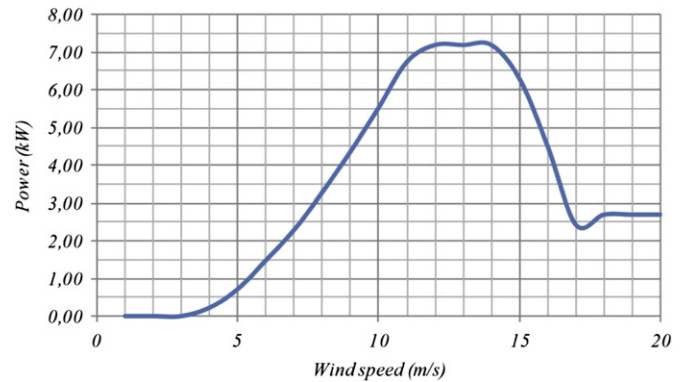


Fig. 6. Wind turbine power curve.

that in a particular time more energy is possible to be generated than what is possible to be stored in battery bank. In such conditions, the wind turbine sub-system or the PV sub-system or both generates less energy than what they are capable to generate. So, the value of daily mean power showed in Table 8 can be smaller than what was estimated and shown in Table 6, without representing error in the estimate of generation capacity of wind turbines.

The values of the residential energy consumption during the period from March to July 2010 are presented in Table 9. Fortunately, these values are relatively smaller than the respective estimated values shown in Table 6. This is good for the system, because it is an indication that the system still has the capacity to supply an expansion of consumption in coming years. The reduced consumption compared to the estimated one is mainly due to an educational program related to the efficient use of electricity by the community as well as due to the fact that the community needs to pay for energy consumed.

4. Parallel-connected inverters

In the project of the inverters, the goal was to develop a system that, besides highly reliable, it also had capacity for expansion as the loads increase without the need of alterations in the equipments already installed. To considerably increase the reliability and robustness of the system, it was adopted parallel operation of the inverters without communication among the units. The MTBF of inverters connected in parallel, in the $N+1$ or $N+2$ configurations, is greater than that of individual equipment, which demonstrates the reliability provided by this type of operation [13,14]. For the $N+1$ configuration one inverter (N) is able to supply energy to the load. The other inverter ($+1$) is redundant. However, this reliability is only obtained through a system without communication, with units totally autonomous.

Among the several forms used to connect voltage source inverters in parallel, it is possible to classify them in two groups: 1) the systems without communication and 2) the systems with

Table 3
Specifications of the batteries.

Rated capacity at 25 °C and 20 h (C5)	150 Ah
Rated voltage at 25 °C	12 V
Float voltage at 25 °C	13.22–13.80 V
Equalization voltage at 25 °C	14.40–14.89 V
Indicative voltage of full discharge	10.5 V
Round trip efficiency	$\approx 85\%$
Temperature compensation coefficient	–0.030 V for each 1 °C above 25 °C +0.030 V for each 1 °C below 25 °C

Table 4

Local solar potential.

Month	Jan.	Feb.	Mar.	Apr.	Mar.	June	July	Aug.	Sept.	Oct.	Nov.	Dec.	Year
Radiation in (kWh/m ²)/day	4.06	4.56	3.94	4.03	4.39	4.61	4.97	5.61	5.58	5.69	5.72	5.00	4.85
Days in the month	31	28	31	30	31	30	31	31	30	31	30	31	–
Estimate of the generated energy in kWh/month	2227	2259	2161	2139	2408	2447	2726	3077	2962	3121	3036	2742	31303

Table 5

Local wind potential.

Month	Jan.	Feb.	Mar.	Apr.	May	June	July	Aug.	Sept.	Oct.	Nov.	Dec.	Year
Mean wind speed in m/s	6.25	6.25	5.07	5.07	5.07	7.44	7.44	7.44	8.99	8.99	8.99	6.25	6.94
Weibull K factor	2.30	2.30	1.97	1.97	1.97	2.66	2.66	2.66	3.60	3.60	3.60	2.30	2.63
Daily mean power in kW for 1 turbine	1.97	1.97	1.12	1.12	1.12	2.60	2.60	2.60	3.86	3.86	3.86	1.97	2.39
Daily mean gen. energy in kWh/day with 1 turbine	47.40	47.40	26.90	26.90	26.90	62.30	62.30	62.30	92.70	92.70	92.70	47.40	57.33
Monthly mean gen. energy in kWh/month for 1 turbine	1469	1327	834	807	834	1869	1931	1931	2781	2874	2781	1469	20908
Monthly mean gen. energy in kWh/month for 3 turbines	4408	3982	2502	2421	2502	5607	5794	5794	8343	8621	8343	4408	62724

communication. Parallelism with communication, as for instance in master-slave systems, uses an external cable for synchronization of the references and sharing of loads. In the case of a failure in that communication, the whole system can fail, unless another unit assumes the control. Seeking to avoid that type of problem, it was developed a system that works in parallel without any communication among the units. One of the methods more commonly implemented is known as Drooping Method [15–18].

5. System modeling

The hardware design was based on a 20 kVA, three-phase IGBT inverter. The output 60 Hz voltage was regulated based on a space vector pulse width modulation (SVPWM) with a 4 kHz switching frequency. An output low pass filter was used in each phase to eliminate the high frequency harmonic content due to the inverter switch action. Furthermore, a transformer was used to provide galvanic isolation and change the output voltage level. As a final component there is output impedance used to share equally the load between the units. Besides voltage transformation, this isolation transformer was also used to protect the load and the equipments connected in parallel against fail or isolation loss, improving the reliability and robustness of the overall system. The block diagram of the inverter system is presented in Fig. 7. The control system was designed taking into account each of the blocks shown in this figure. This figure shows two inverters connected in parallel to emphasize the $N+1$ operation that was adopted. The system controls the output voltage of each individually inverter and the load share between the units. The output voltages are measured using voltage transformers and the measured voltages are converted to digital form using the analog to digital converters input (ADCIN) of the DSP

TMS320LF2407. These values are compared to the reference ones, and generate the errors input to the voltage controllers. The voltage controllers generate the inputs to the SVPWM that generate the pulses to the switches of the inverters. The load share between units is based on the control of the frequency of the output voltages using the drooping method [15–18].

In Fig. 8 there is a more precise idea of the voltage control algorithm that was implemented. In this figure it is shown the control block diagram of just one inverter. The other inverters working in parallel have the same control topology. Because there are two controllers, one for each voltage component, the diagram was drawn using rotating vectors: two lines in the diagram stands for voltage vector.

The control of the system is accomplished by two loops: an inner loop responsible for the fastest dynamics, and an outer loop responsible for the slowest dynamics. The inner loop is based on a PD controller that has a widespread use in industry and easy to tune. It is responsible to track the sinusoidal voltage reference. In this inner loop, the PD controller works with sinusoidal signals. To achieve a zero steady state error an outer loop was implemented to control the RMS level of the output voltage through a PI controller. Since the RMS is a dc value to the PI controller, it guarantees zero steady state error. On the other hand, applying a PI controller directly in the inner loop can reduce but will not achieve zero steady state error due the frequency response characteristics of the integral block of the PI controller.

6. Protections & coordination

The first thing that was adjusted during the start-up procedure was the general coordination protection against over currents and

Table 6

Energy balance between estimated generation and estimated consumption.

Generated energy in (kWh)	Jan.	Feb.	Mar.	Apr.	May	June	July	Aug.	Sept.	Oct.	Nov.	Dec.	Year
Month	1	2	3	4	5	6	7	8	9	10	11	12	–
PV solar	2227	2259	2161	2139	2408	2447	2726	3077	2962	3121	3036	2742	31303
Wind	4408	3982	2502	2421	2502	5607	5794	5794	8343	8621	8343	4408	62724
Total generation	6635	6240	4663	4560	4909	8054	8520	8871	11305	11742	11379	7150	94027
Residential consumption	4134	4139	4144	4150	4155	4160	4165	4170	4175	4181	4186	4191	49950
Productive consumption	1912	1912	1912	1912	1912	1912	1912	1912	1912	1912	1912	1912	22939
Total consumption	6046	6051	6056	6061	6066	6071	6077	6082	6087	6092	6097	6103	72889
(Generation - consumption)	589	190	–1393	–1501	–1157	1982	2443	2789	5218	5650	5282	1048	21138

Table 7
Measures of power generation with the solar panel on first semester of 2010.

Month	Mar.	Apr.	May	June	July
Maximum power generated in kW	16.66	16.98	15.88	16.40	17.08
Daily mean power in kW	3.32	2.95	3.29	3.57	3.70
Mean generated energy in kWh	2369.3	2032.8	2414.2	2459.8	2637.2

short circuits. The protection was done by using electromagnetic breakers, type B (standard IEC 898). The nominal current was chosen to be 5 A. This low value is justified based on the installed load in the houses, in general below 500 VA. The type B devices allow the coordination protection against short circuits between the house breakers and the inverters. The actuation of this device for currents above 5 times rated current is in the range of 10 ms. As a result, the breakers open almost instantly for currents above 25 A. This setup was enough to coordinate this protection and the one imposed by the inverters itself that is 32 ms for currents above 1.5 times rated phase current. After this adjust the protection of the system begun operation without failures caused by short circuits.

Another important aspect is the start-up of the inverters after a fault or intentionally turns off for maintenance or any other reason. Because the system and the inverters have limited power the inrush current during the start-up could eventually shut down the inverters. The way the system was designed anytime the inverters have to be turned off for maintenance the diesel generator backup system is turned on. By the time the inverters are turned on the diesel generator is already supplying the load, and there is no inrush current that can cause the inverters shut down when the load is transferred from the diesel generator to the inverters. In case of a fault the following two procedures were tested to mitigate the problems caused by the inrush current:

- 1) Anytime the system has to be started-up after a fault the following turn on sequence is applied:
 - Turn on the diesel generator and supply the load;
 - Turn on the first inverter;
 - Parallel the other inverters with the first one that was previously turned on;
 - Transfer the load to the inverter system;
 - Turn off the diesel generator;
- 2) In the second procedure the load circuits are partitioned. In the case of the proposed system, there are four sectors (north, south, east, and west). The inverters are turned on in the same manner as in the first procedure, and the load is applied sequentially, sector by sector. This second procedure is preferred since it is not necessary to turn on the diesel generator.

The aerial distribution network should be based on insulated cables due to the aggressive marine environment. The public illumination must also be protected against the hazardous environmental conditions. Due to limited energy resources the public

Table 8
Measures of power generation with the wind power sub-system on first semester of 2010.

Month	Mar.	Apr.	May	June	July
Daily mean power in kW with 1 turbine	1.35	0.86	0.89	0.90	0.80
Mean generated energy by 1 turbine in kWh/day	29.71	18.77	19.39	19.89	17.78

Table 9
Measures of residential energy consumption from March to July of 2011.

Month	Mar.	Apr.	May	June	July
Residential energy consumption in the first semester of 2011 in kWh	2908	3283	3221	3436	3480

illumination is based on compact fluorescent lamps. The solution implemented in the proposed system is presented in Fig. 9.

7. Performance

Unlike large interconnected systems, in standalone systems with light load, power quality varies significantly with the size and type of loads, with major implications in the reliability of operation. Due to government policy for energy efficiency in isolated systems, efficient lamps should be used in homes and public lighting. Typical fluorescent lamps with electronic ballast are used, contributing to degrade the current and voltage waveforms.

In fact, the load current at the Lençóis Island is strongly distorted. But even with this kind of current the controller regulates the inverter voltages with small THD_v. Figs. 10–12 show the voltage, current and instantaneous power of the phases R, S, and T, measured with the systems supplying energy to the entire island.

Through the results presented in Figs. 10–12, it is possible to observe the unbalance of the system due to different loads supplied by the inverters. They were submitted not only to different current waveforms but also to different output current levels (unbalanced operation). Nevertheless, they maintain the output voltage stable and with low distortion level.

It can be observed that even with a huge current total harmonic distortion (THD_i) due to the non-linear load of the island (see Fig. 13), the inverter output voltage has a THD_v smaller than 5%. This result can be observed in Fig. 14. This THD_v level depends on the load conditions.

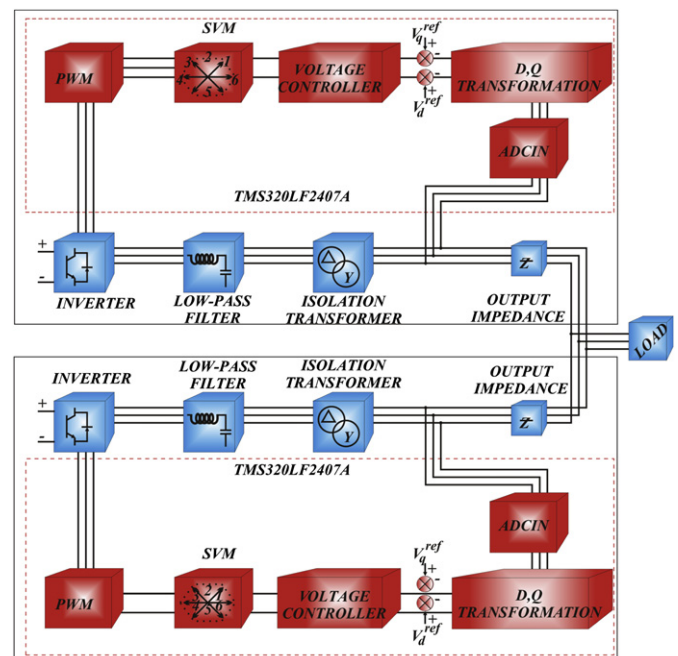


Fig. 7. Block diagram of 2 inverters in parallel ($N+1$).

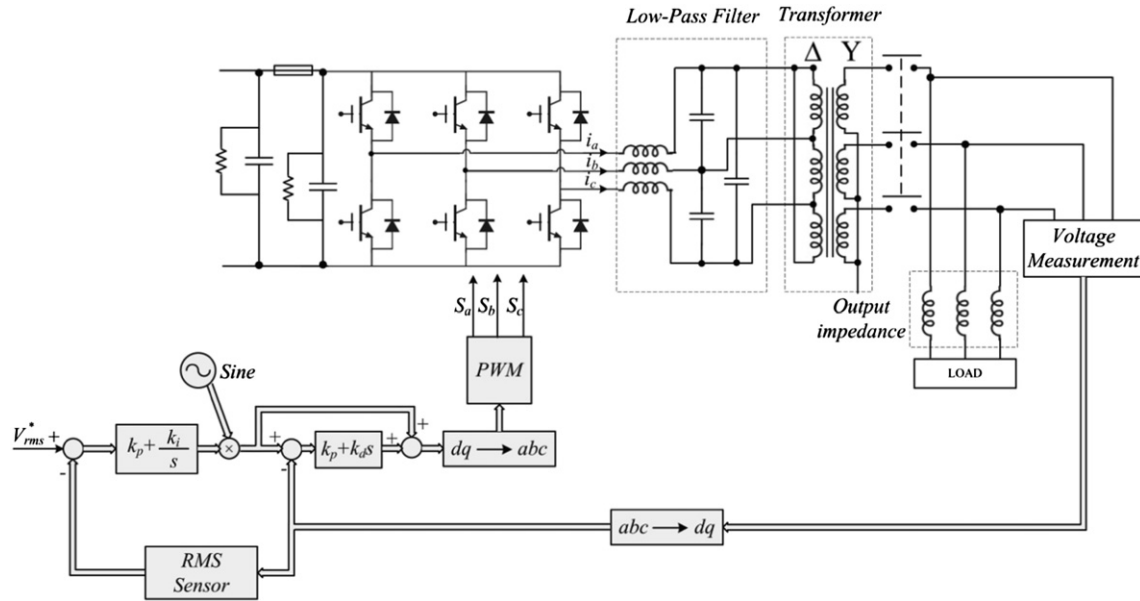


Fig. 8. Diagram of the control system.

8. Efficiency

Another important aspect to be considered is the global efficiency of the equipments. The bigger the efficiency is the better will be the use of the generated energy. Table 10 shows the efficiency of the inverters measured in the laboratory with the inverters

supplying nominal linear load. It must be noted that the efficiency results presented in Table 10 are different from the results obtained in the island because the load conditions during the tests were different.

During the first three years of operation, the load never gets to the values showed in Table 10. Instead the peak power was approximately 10 kW. As a result the efficiency measured in the field is smaller than the efficiency measured in the laboratory, especially because the inverters are supplying non-linear, unbalanced loads at Lençóis Island. Fig. 15a shows the input and output power measured in a typical day of February, 2010. And Fig. 15b shows the efficiency calculated in the same period. The maximum efficiency was approximately 90.5%, measured at the time when the load is at its maximum.



Fig. 9. View of the aerial distribution network.

9. Reliability indices

Since July, 20th 2008 the system has been in operation. The first year - 160 days - was considered as a testing period and 2009–2011

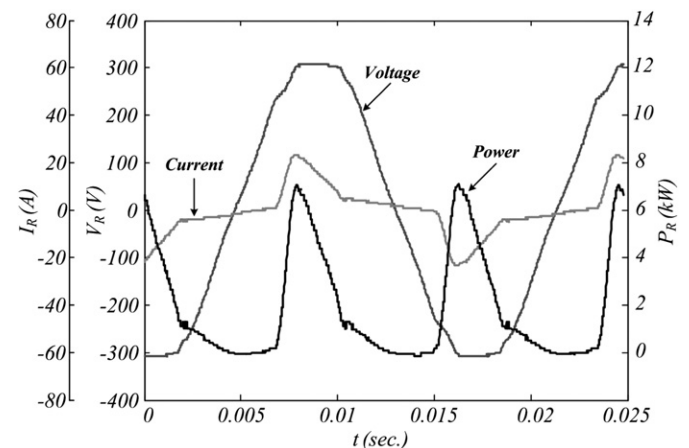


Fig. 10. Inverter output voltage, current and instantaneous power of phase R with the system working at the island.

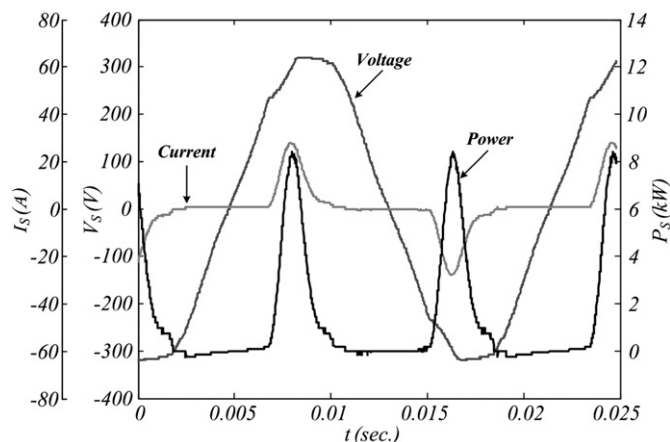


Fig. 11. Inverter output voltage, current and instantaneous of phase S with the system working at the island.

as steady state operation. There are many indices for measuring reliability. The most common are referred to as SAIFI and SAIDI, defined in IEEE Standard 1366 as system average interruption frequency index and system average interruption duration index, respectively. These indices are equivalent to FEC and DEC, respectively, used in Brazil.

As a reference, a typical distribution company of Sao Paulo, Brazil reported in 2008 SAIFI = 5.87 and SAIDI = 6.85 h. From July, 20th to December 31st of 2008, the indices obtained from Lençois system were: SAIFI = 3 and SAIDI = 72 h. In this first year, just 24 h were provided by diesel generator, representing only 0.609% of the period (164 days or 3936 h). Therefore, during 99.390% of this time the demand was supplied by renewable wind – solar sources.

At the second year (2009), no supply interruptions have been registered, leading to SAIFI = 0 and SAIDI = 0. These good reliability indices are attributed to the good automation degree of the system and to the small scale distribution network as well, adequately prepared for marine environmental conditions. Table 11 summarizes the indices of the system operation over the period 2009–2010.

The current and voltage measured in a typical day of December/2009 are showed in Fig. 16, which shows the RMS values of currents and voltages measured in a period of approximately 10 h. It can be observed that the system is unbalanced and

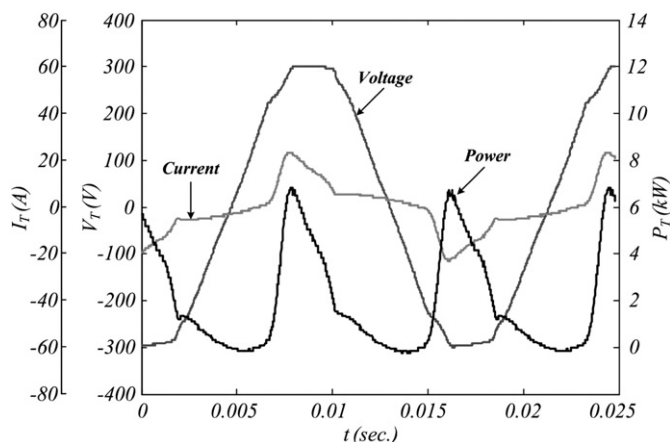


Fig. 12. Inverter output voltage, current and instantaneous power of phase T with the system working at the island.

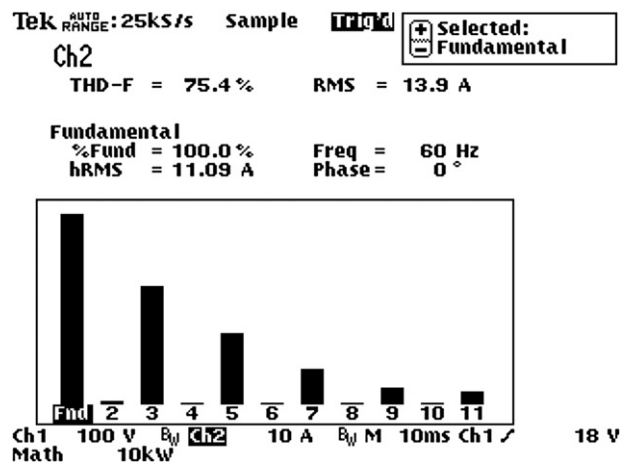


Fig. 13. Inverter output current THD with today's island load.

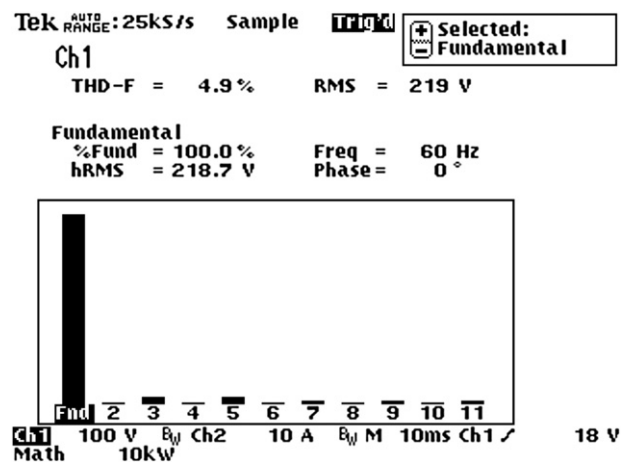


Fig. 14. Inverter output voltage THD with today's island load.

that the currents have high harmonic content since the neutral current is high. Even with this high current harmonic content the variations of the voltages RMS values are within $\pm 2\%$ of the rated value (220 V).

The total harmonic distortions of the currents (THD_i) and voltage (THD_v), measured in the same day of Fig. 16 are presented in Fig. 17. It can be shown the high THD_i (Fig. 17a) caused by the non-linear loads (fluorescent lamps, TVs, and refrigerators). This distortion and the load unbalance cause a $THD_v > 5\%$ (Fig. 17b) during some hours.

To bring the THD_v to levels within the IEEE recommended practices ($THD_v < 5\%$) it was tested to reduce the amount of unbalance to levels below 50% among the phases. Then part of the load was relocated among the phases. By just doing this simple task the THD_v was improved as can be seen in Fig. 18. These data were measured in February/2010 by the time there was another travel to the island. Even though the data was measured in a different day

Table 10
Efficiency results.

Equipment	Input power (kW)	Output power (kW)	Efficiency (%)
Inverter 1	20.5	19.1	93.17
Inverter 2	19.1	17.4	91.09

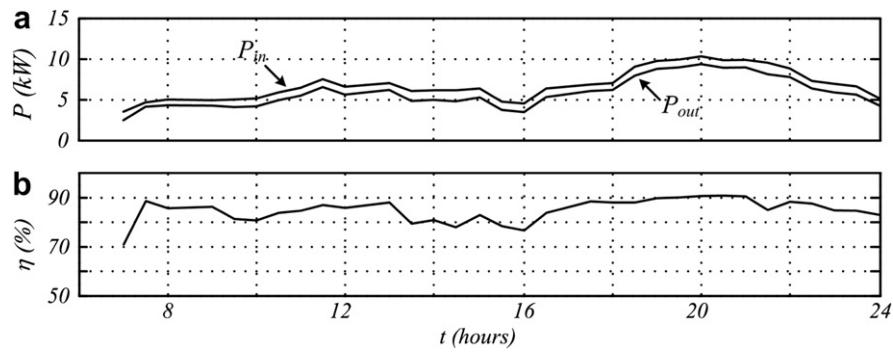


Fig. 15. (a) Input and output power of the inverter; (b) efficiency.

Table 11
System operation indices.

System operation	SAIFI	SAIDI	Renewable energy operation	Diesel operation
1st year (3936 h)	3	72	99.39%	0.61%
2nd year (8760 h)	0	0	95.43%	4.56%
3rd year (8760 h)	2	48	92.30%	7.70%

the results were taken in time intervals where it was observed the worst THD_v.

Fig. 19 illustrates the individual contribution of renewable resources and battery bank charge in August, 8, 2009. Negative values indicate that the battery bank is discharging, i.e., it is complementing the load balance. For this day, a slight complementary behavior among solar and wind energies is observed. In general, this behavior cannot be sustained over several months. Typically, hot and sunny days are accompanied by winds.

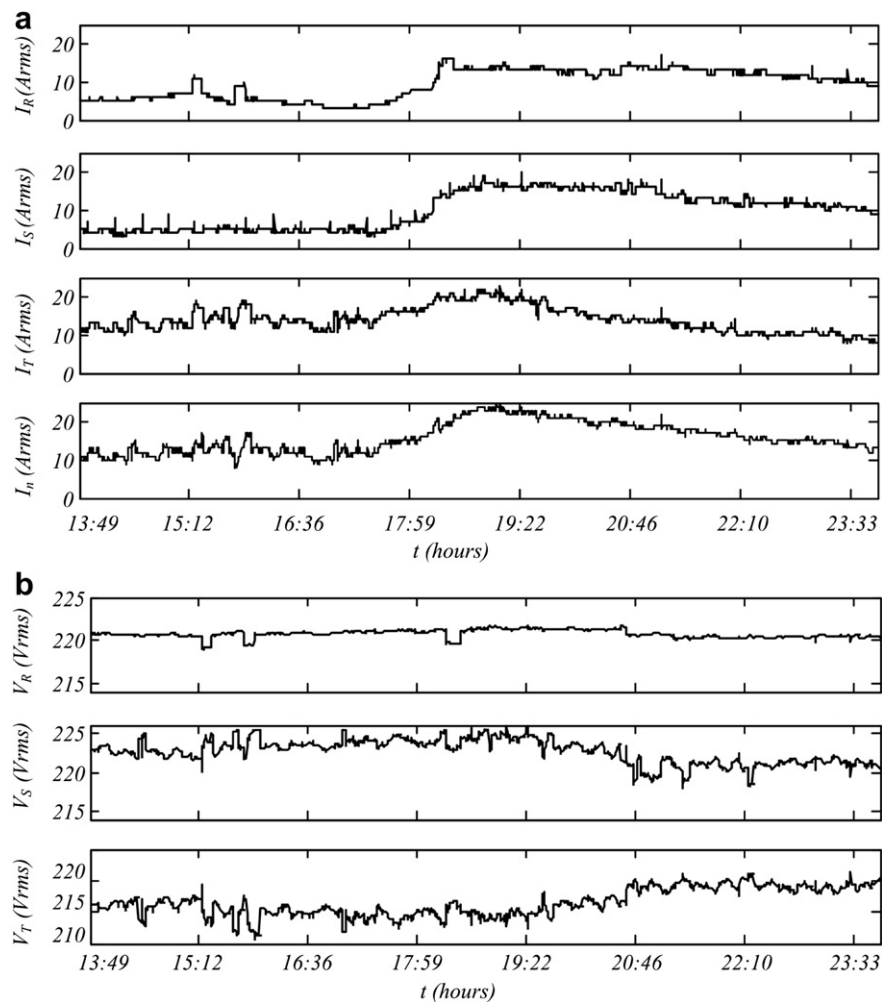


Fig. 16. RMS values of current (a) and voltage (b) measured in December/2009.

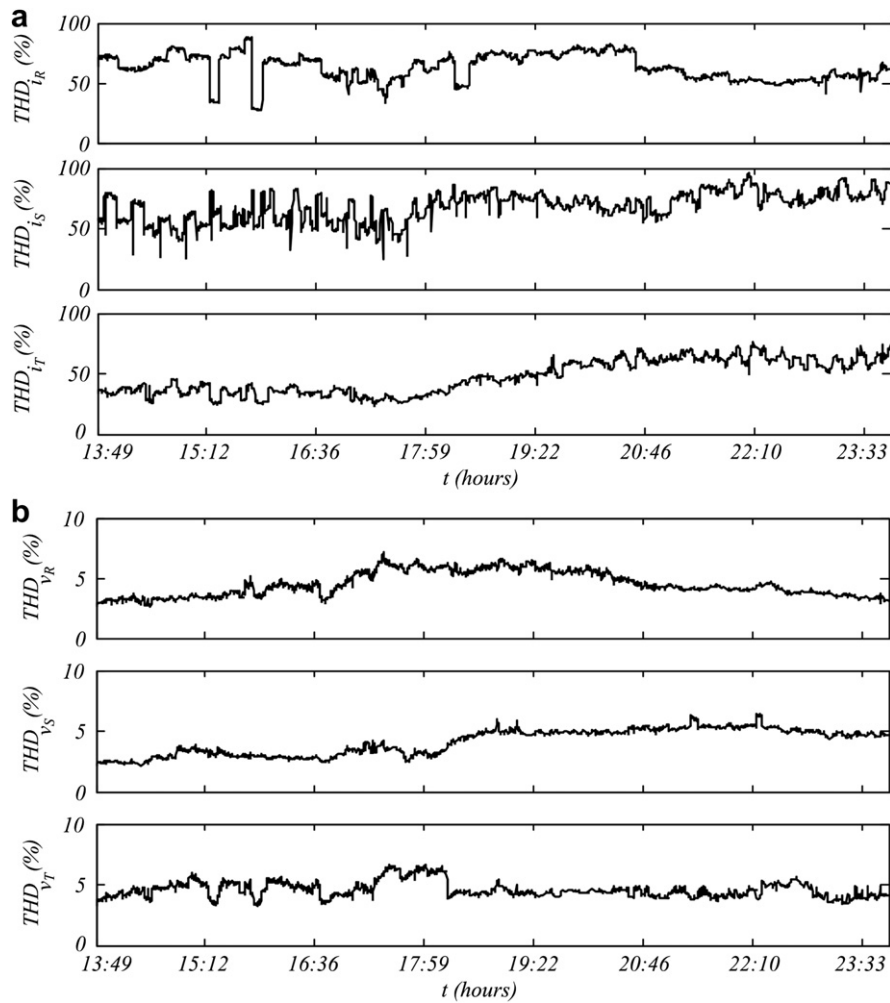


Fig. 17. Total harmonic distortion of currents (a) and voltage (b).

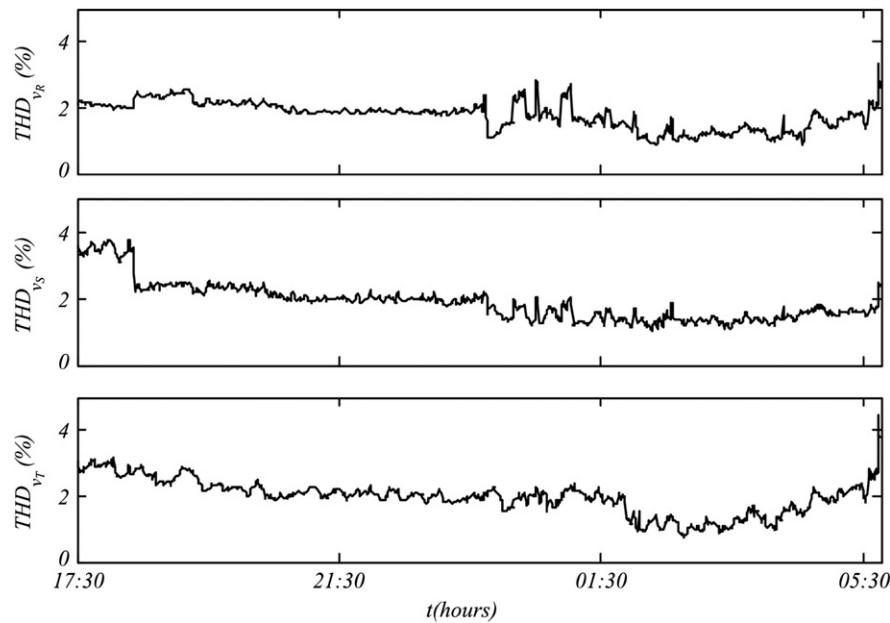


Fig. 18. Total voltage harmonic measured after load balance.

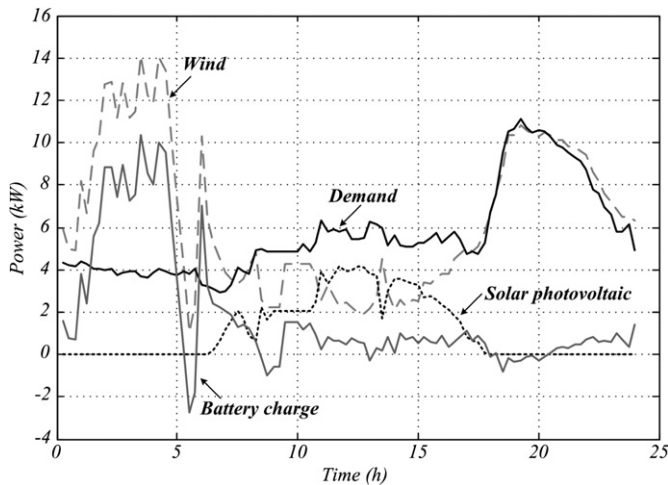


Fig. 19. Daily participation of renewable sources and battery bank.

10. Conclusions

Fulfilling a few critical issues it is possible turn reliable renewable hybrid generation systems based on solar photovoltaic and wind energies. These systems definitely help to bring energy to isolated islands and decrease the CO₂ emissions. However, due to the low energy demand and difficult access to isolated areas it is necessary to build a system that is reliable, efficient and presents enough flexibility to load increases. It was shown that these requirements can be fulfill with parallel operation of inverters specially designed for these applications, adequate automation level, practical protection coordination, and using a distribution network adapted to local climate conditions. Experimental results show that the power quality supplied to the consumers is very good. The main feature to be pursued is the reliability of the system, mainly the reliability of the inverters that can be improved by parallel operation.

The practical experience reported here shows the robustness of the system when submitted to load step variations, non-linear loads, and the advantages of parallel operation. The system is

working in perfect conditions since June 2008 at Lençóis Island, Cururupu, MA, northeast of Brazil.

References

- [1] Ribeiro LAS, Saavedra OR, Matos JG, Bonan G, Martins AS. "Small Renewable Hybrid System for Stand Alone Applications", in IEEE Symposium on Power Electronics and Machines in Wind Applications (PEMWA 2009), Lincoln, Nebraska, pp. 1–7, 2009.
- [2] Ribeiro LAS, Saavedra OR, Matos JG, Lima SL, Bonan G, Martins AS. Isolated micro-grid with renewable hybrid generation: the case of Lençóis island. IEEE Transactions on Sustainable Energy January 2010;2(1):1–11.
- [3] Flowers L, Baring-Gould I, Bianchi J, Corbus D, Drouilhet S, Elliott D, et al. Renewables for sustainable village power. In: American wind energy association's windpower 2000 conference. California: Palm Springs; November 2000. p. 1–10.
- [4] Baring-Gould EI, Newcomb C, Corbus D, Lalidas R. Field performance of hybrid power systems. In: American wind energy association's windpower 2001 conference; September 2001. p. 1–10. Washington, D.C.
- [5] Foster RE, Orozco RC, Rubio ARP. Lessons learned from the Xcalak hybrid system: a seven year retrospective. In: Proc. of 1999 solar world conference, vol. I. Jerusalem: International Solar Energy Society; July 1999. p. 319–28.
- [6] Corbus D, Newcomb C, Yewdall Z. San Juanico hybrid power system technical and institutional assessment. In: Proc. of World Renewable Energy Congress VIII (WREC VIII); August 2004. p. 1–5. Denver, Colorado.
- [7] Jiayi H, Chuanwen J, Rong X. A review on distributed energy resources and MicroGrid. Elsevier Renewable and Sustainable Energy Reviews June 2007; 12(9):2472–83.
- [8] Nelson VC, Foster RE, Clark RN, Raubenheimer D. Wind hybrid system technology characterization. NREL – National Renewable Energy Laboratory; 2002. 50 pp.
- [9] Bergey Windpower Co. (2011, Maio) [Online]. www.bergey.com.
- [10] Cresesb (2011, August) [Online]. <http://www.cresesb.cepel.br/sundata/index.php#sundata>.
- [11] Cresesb (2011, August) [Online]. http://www.cresesb.cepel.br/atlas_eolico/index.php.
- [12] Manwell JF, Mcgowan JG, Rogers AL. Wind energy explained: theory, design, and application. 2nd ed. Chichester, England: John Wiley & Sons, Ltd; 2009.
- [13] Wood AP. Reliability-metric varieties and their relationships. In: Proc. of the reliability and maintainability symposium; 2001. p. 110–5.
- [14] Lewis EE. Introduction to reliability engineering. John Wiley & Sons Inc; 1987.
- [15] Guerrero JM, Garcia de Vicuña L, Matas J, Castilla M, Miret J. A wireless controller to enhance dynamic performance of parallel inverters in distributed generation systems. IEEE Transactions on Power Electronics Sep. 2004;19(5): 1205–13.
- [16] Chen Z, Hu Y. Control of power electronic converters for distributed generation units. In: Proc. of IECON 2005 Conf.; Nov. 2005. p. 1317–22.
- [17] Chen Z, Hu Y, Blaabjerg F. "Control of distributed power systems. In: Proc. IPEMC, 3; 2006. p. 1–6.
- [18] De Brabandere K, Bolsens B, Van Keybus J, Woyte A, Driesen J, Belmans R. A voltage and frequency droop control method for parallel inverters. IEEE Transactions on Power Electronics July 2007;22(4):1107–15.